



PHILIPPINE HEART CENTER
East Avenue, Quezon City

SUPPLEMENTAL BID BULLETIN No. 099-2022

SUBJECT : Modifications/Amendments in the Bidding Documents

PROJECT/S : 1 Lot Provision of Independent Power Supply at Annex Building - ITB No. 130.22

To ensure that the transactions are comparatively advantageous to the interests of the PHC, the originally pre-issued technical specifications as mentioned above, revisions/changes are hereby introduced.

Item No./ Page No.	PHC – Technical Specifications FROM	Clarifications/Modifications (Should be read as) TO
		Attached herewith is the Single Line Diagram of the above-cited Project.
Page 10	Delivery Period = 90 calendar days	Delivery Period = 120 calendar days

This Supplemental Bid Bulletin is hereby issued to modify the original parameters as stated therein. All other requirements previously stated on the bid documents must be complied.


Please be guided accordingly.

Approved. Done this 16th day of December 2022, BAC Office, PHC.

RANULFO B. JAVELOSA, JR., MD.
Chairman, BAC for Infra, Med Supplies and Services

SERVICE ENTRANCE 3Ø
34.5 KV/230V, 60Hz, AC

1 MVA, 3P PAD MOUNTED
TRANSFORMER 34.5 KV/230V
60 Hz, AC DELTA - WYE
NEUTRAL WITH GROUNDING

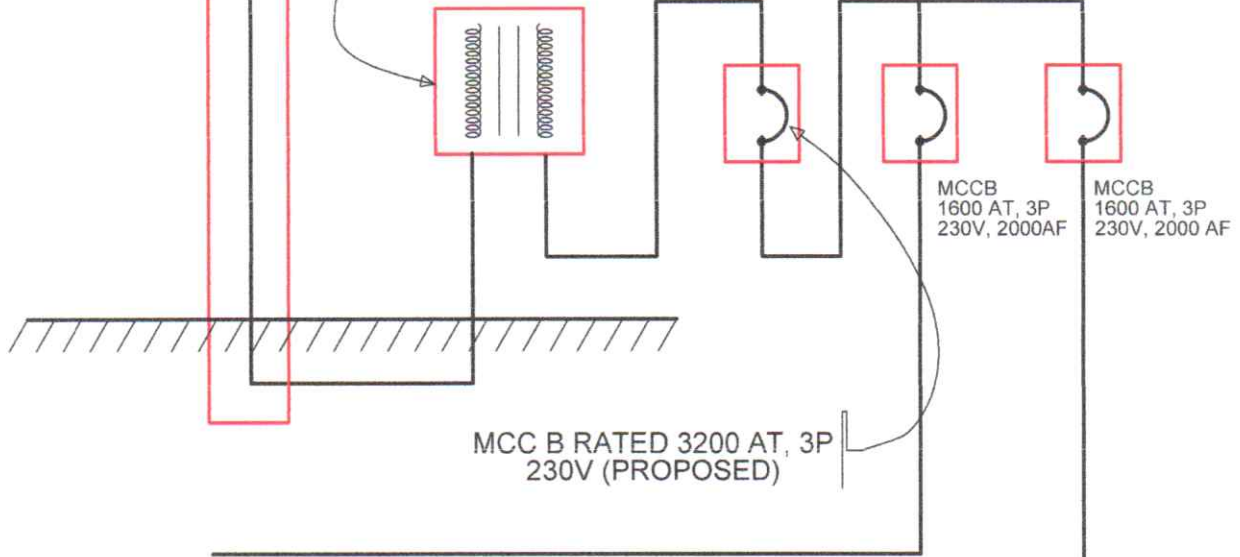


EXISTING LOADS
TO BE TAPPED
AT THE NEW
INSTALLATIONS

1,600A, 3P
230V





FROM 625 KVA
230V, 3P, EMERGENCY
GENSET

(ATS) AUTOMATIC
TRANSFER SWITCH



1,600A, 3P
230V

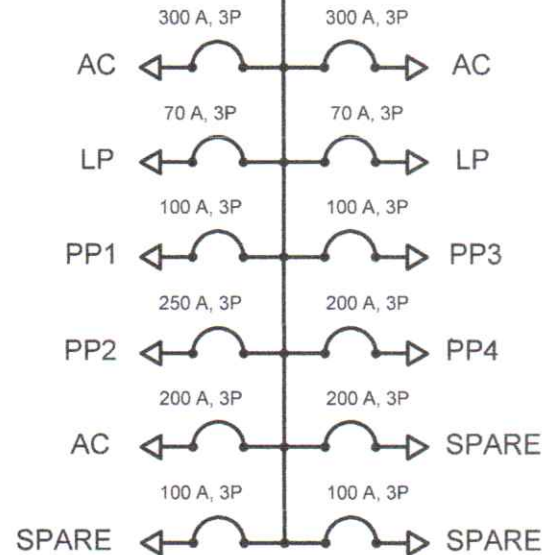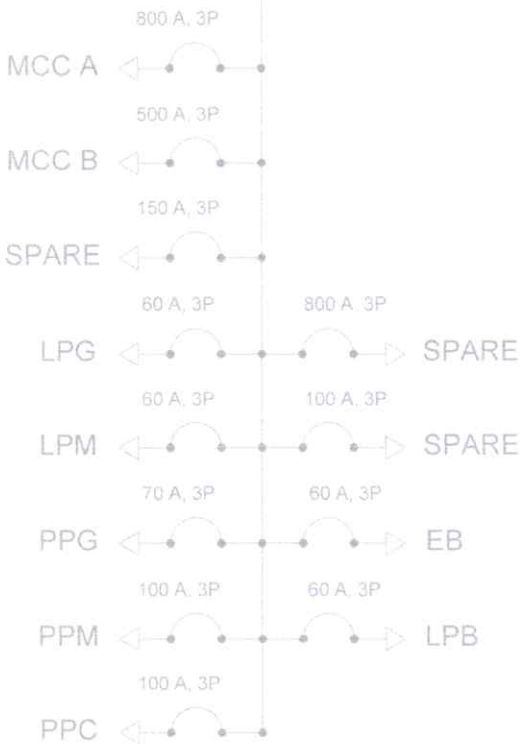

SINGLE LINE DIAGRAM

MAB ANNEX BUILDING